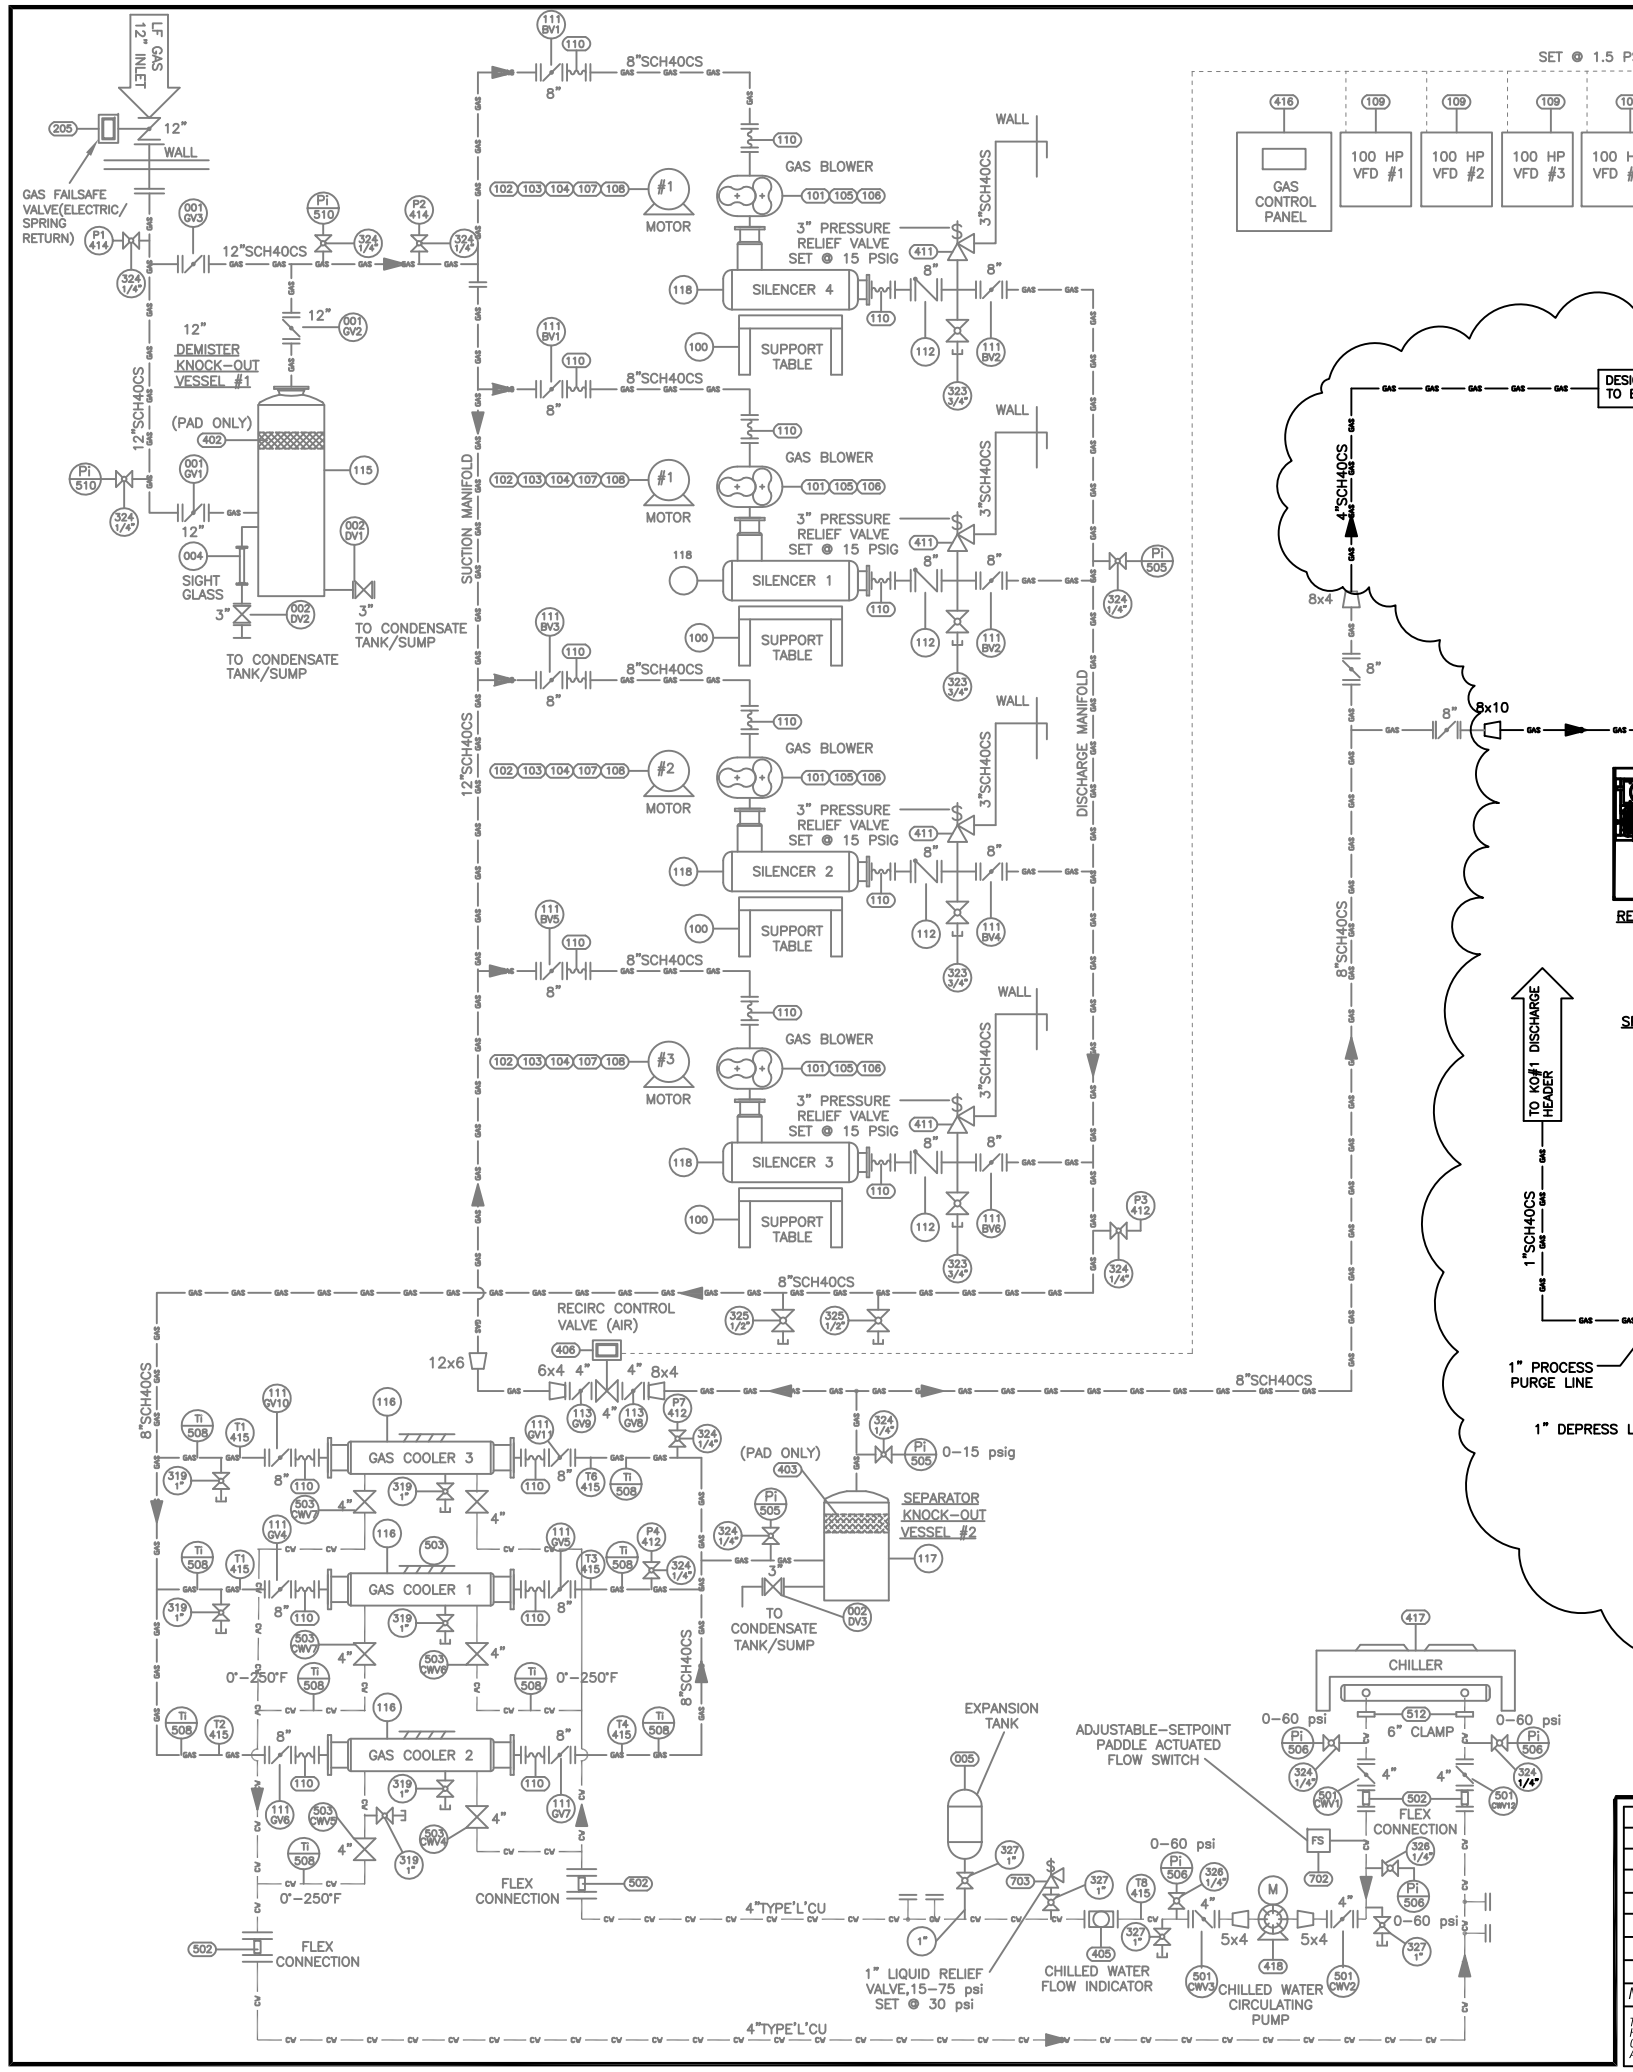

FOR BID ONLY - NOT FOR CONSTRUCTION

LEGEND

- ELECTRICAL INSTRUMENT LINE
- LANDFILL GAS
- DILUTE GLYCOL
- CONCENTRATED GLYCOL
- CHILLED WATER
- HOT WATER

PRESSURE
P1 0-20 PSIA VACUUM TRANSDUCER
P2 0-20 PSIA VACUUM TRANSDUCER
P3 0-15 PSIG PRESSURE TRANSDUCER
P4 0-15 PSIG PRESSURE TRANSDUCER
P5 0-15 PSIG PRESSURE TRANSDUCER
P6 0-15 PSIG PRESSURE TRANSDUCER
P7 0-15 PSIG PRESSURE TRANSDUCER

TEMPERATURE
T1 100 OHM PLATINUM RTD (INLET COOLER 1)
T2 100 OHM PLATINUM RTD (INLET COOLER 2)
T3 100 OHM PLATINUM RTD (OUTLET COOLER 1)
T4 100 OHM PLATINUM RTD (OUTLET COOLER 2)
T5 100 OHM PLATINUM RTD (INLET COOLER 3)
T6 100 OHM PLATINUM RTD (OUTLET COOLER 3)
T7 100 OHM PLATINUM RTD (CW DISCHARGE PUMP)
T8 100 OHM PLATINUM RTD (CW DISCHARGE PUMP)

FLOW
F1 0-3000 SCFM FLOW METER

Ti TEMPERATURE GAUGE
Pi PRESSURE GAUGE

(M) MOTOR

CS CARBON STEEL
SS STAINLESS STEEL

(203) IES TAG NO.

NO.	REVISIONS	DATE	BY

THIS DRAWING AND THE DESIGNS, DETAILS AND/OR ENGINEERING INFORMATION CONTAINED HEREON ARE THE PROPRIETARY PROPERTY OF ARIA ENERGY AND ARE NOT TO BE REPRODUCED OR USED EXCEPT FOR THE PURPOSE FOR WHICH THEY HAVE BEEN FURNISHED. ALL RIGHTS OF DESIGN AND INVENTION ARE HEREBY RESERVED.

aria energy
46280 DYLAN DRIVE
NOVI, MICHIGAN 43377
(248) 380-3920

PROJECT: LFGTE FACILITY - COVENTRY, VERMONT

DRAWING TITLE: SRS & FLARE P & ID

DRAWN BY:	DATE:	CAD DRAWING NO.:	DRAWING NO.:
JG	7/20/15		C1
CHECKED BY: KS	SCALE:	SHEET NO.:	